


- ① GALVANIZED IRON DRIP EDGE
- ② 2 x FASCIA
- ③ PATIO BEAM, SEE PLAN FOR SIZE
- ④ APPROVED COLUMN CAP WITH UPLIFT RATING
- ⑤ POST, SEE PLAN FOR SIZE
- ⑥ HURRICANE TIE @ EA. ROOF RAFTER
- ⑦ PATIO RAFTER, SEE PLAN FOR SIZE & SPACING
- ⑧ 1/2" CDX PLYWOOD SHEATHING
- ⑨ 2 x SOLID BLOCKING
- ⑩ EDGE NAILING 8d @ 6" O/C MIN.
- ⑪ 3-16d/BAY TOENAILING TO TOP PLATE

## ② PATIO BEAM CONNECTION

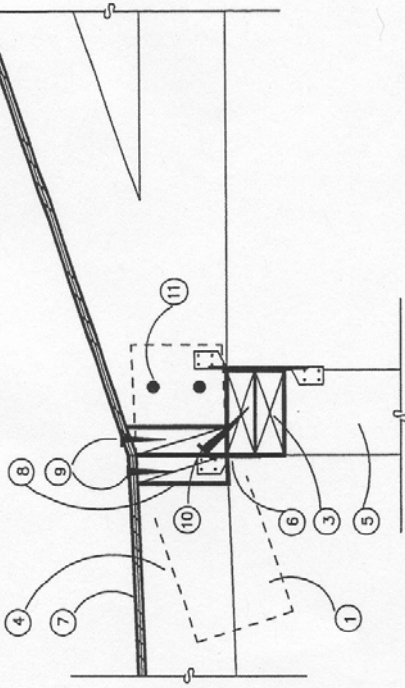

- ① CUT OVERHANG OFF, FLUSH W/ TOP PLATE
- ② DOUBLE TOP PLATE
- ③ NEW JOISTS BEARING ON TOP PLATE, SEE PLAN FOR SIZE
- ④ EXISTING STUD WALL
- ⑤ HURRICANE TIE @ EA. ROOF RAFTER OR FACE NAIL TO EXIST TRUSS
- ⑥ 1/2" CDX PLYWOOD SHEATHING
- ⑦ 2 x SOLID BLOCKING
- ⑧ EDGE NAILING 8d @ 6" O/C MIN.
- ⑩ 3-16d/BAY TOENAILING TO TOP PLATE
- ⑪ MINIMUM TWO 10d NAIL

## ③ PATIO ROOF TO EXISTING HOUSE